
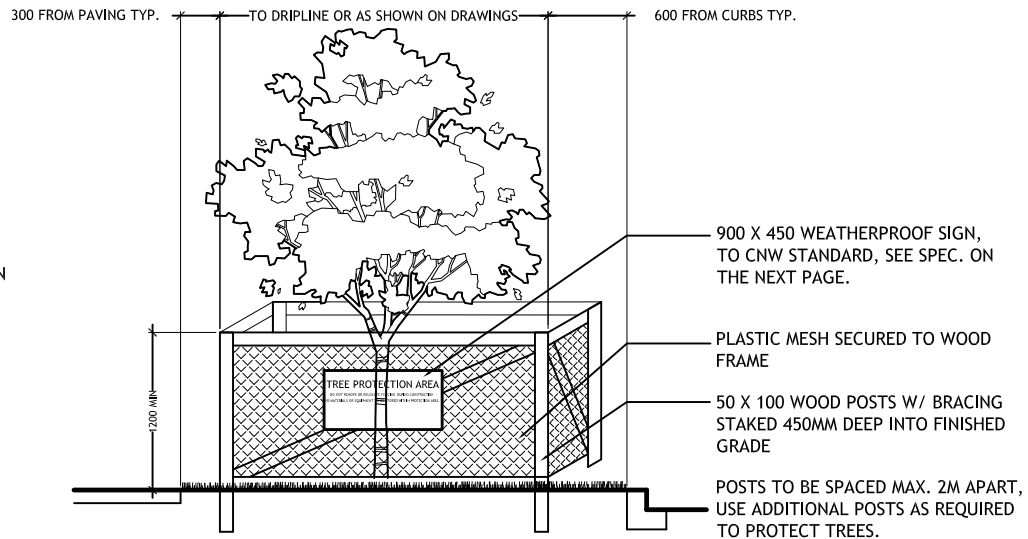


TRUNK DIAMETER X (cm)	MINIMUM PROTECTION REQUIRED AROUND TREE- DISTANCE FROM TRUNK Y (m)
X	6X
20 cm	1.2 m
25 cm	1.5 m
30 cm	1.8 m
35 cm	2.1 m
40 cm	2.4 m
45 cm	2.7 m
50 cm	3.0 m
55 cm	3.3 m
60 cm	3.6 m
75 cm	4.5 m
90 cm	5.0 m
100 cm	6.0 m

NOTES:

- 1) REFER TO CITY OF NEW WESTMINSTER (CNW) TREE PROTECTION BY-LAWS FOR STANDARD REQUIREMENTS.
- 2) INSTALL TREE PROTECTION BARRIER BEFORE CONSTRUCTION BEGINS AND KEEP IN PLACE UNTIL LANDSCAPE CONSTRUCTION IS COMPLETE.
- 3) STORAGE OF BUILDING MATERIALS AND LITTER WITHIN OR AGAINST TREE PROTECTION BARRIER IS PROHIBITED. DEVELOPER/ OWNER RESPONSIBLE FOR MAINTENANCE WITHIN TREE PROTECTION BARRIER.
- 4) DAMAGED TREES TO BE REPLACED AT DEVELOPER'S/ OWNER'S COST.
- 5) MAINTAIN EXISTING GRADES AT PROTECTION BARRIER FOR ALL PROTECTED AND RETAINED TREES.
- 6) REGRADING OUTSIDE OF THE PROTECTION BARRIER SHOULD NOT ADVERSELY COMPROMISE PROTECTED, RETAINED AND EXISTING TREES.

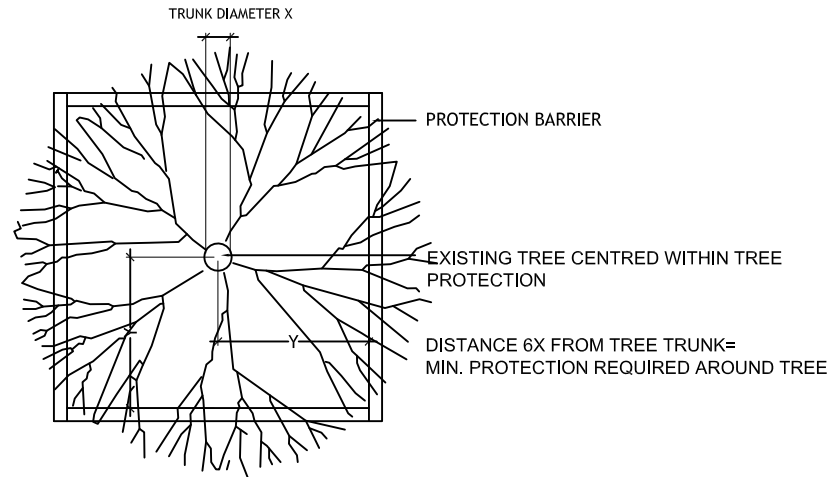

 **Tree Protection Fencing**
NTS

TREE PROTECTION BARRIER SIGN SPECIFICATIONS:

THE SIGN SHOULD BE PRINTED ON YELLOW CHLOROPLAST AT 24" WIDE AND 12" HIGH.

