



## CORPORATION OF THE CITY OF NEW WESTMINSTER

August 18, 2010

**ADDENDUM #1  
NWIT-10-21A  
Heat Pumps Addition  
Engineering Operations Main Building, New Westminster, BC**

This addendum modifies the Invitation to Tender only as noted:

### **SPECIFICATIONS**

#### **General Requirements, 19.0 Hours of Work**

- 1 Paragraph 19.1 <Revise to read> "...prior to 7:30 am and after 4:00 pm..."

### **DRAWINGS**

#### **Drawing M-1 Demolition Plan**

- 1 Add the location of the existing electrical panel as per sketch SKA-1 dated August 18, 2010 (1 page attached) <ADD> Sketch SKA-1. The City has confirmed that the panel has the capacity to provide the required power to the mechanical equipment specified.



#### **Drawing M-4 Specifications**

- 2 Scope, paragraph 2 – <ADD> "All wiring conduit must be concealed. Where concealment is not possible, and is accepted by the Owner, wiring travelling in exposed finished areas must be in solid conduit and painted to match the surface adjacent."

Please acknowledge this Addendum on page 2 of 4 of the Bid Form.

Yours truly,

Heather M. Rossi  
Intermediate Buyer  
email: hrossi@newwestcity.ca

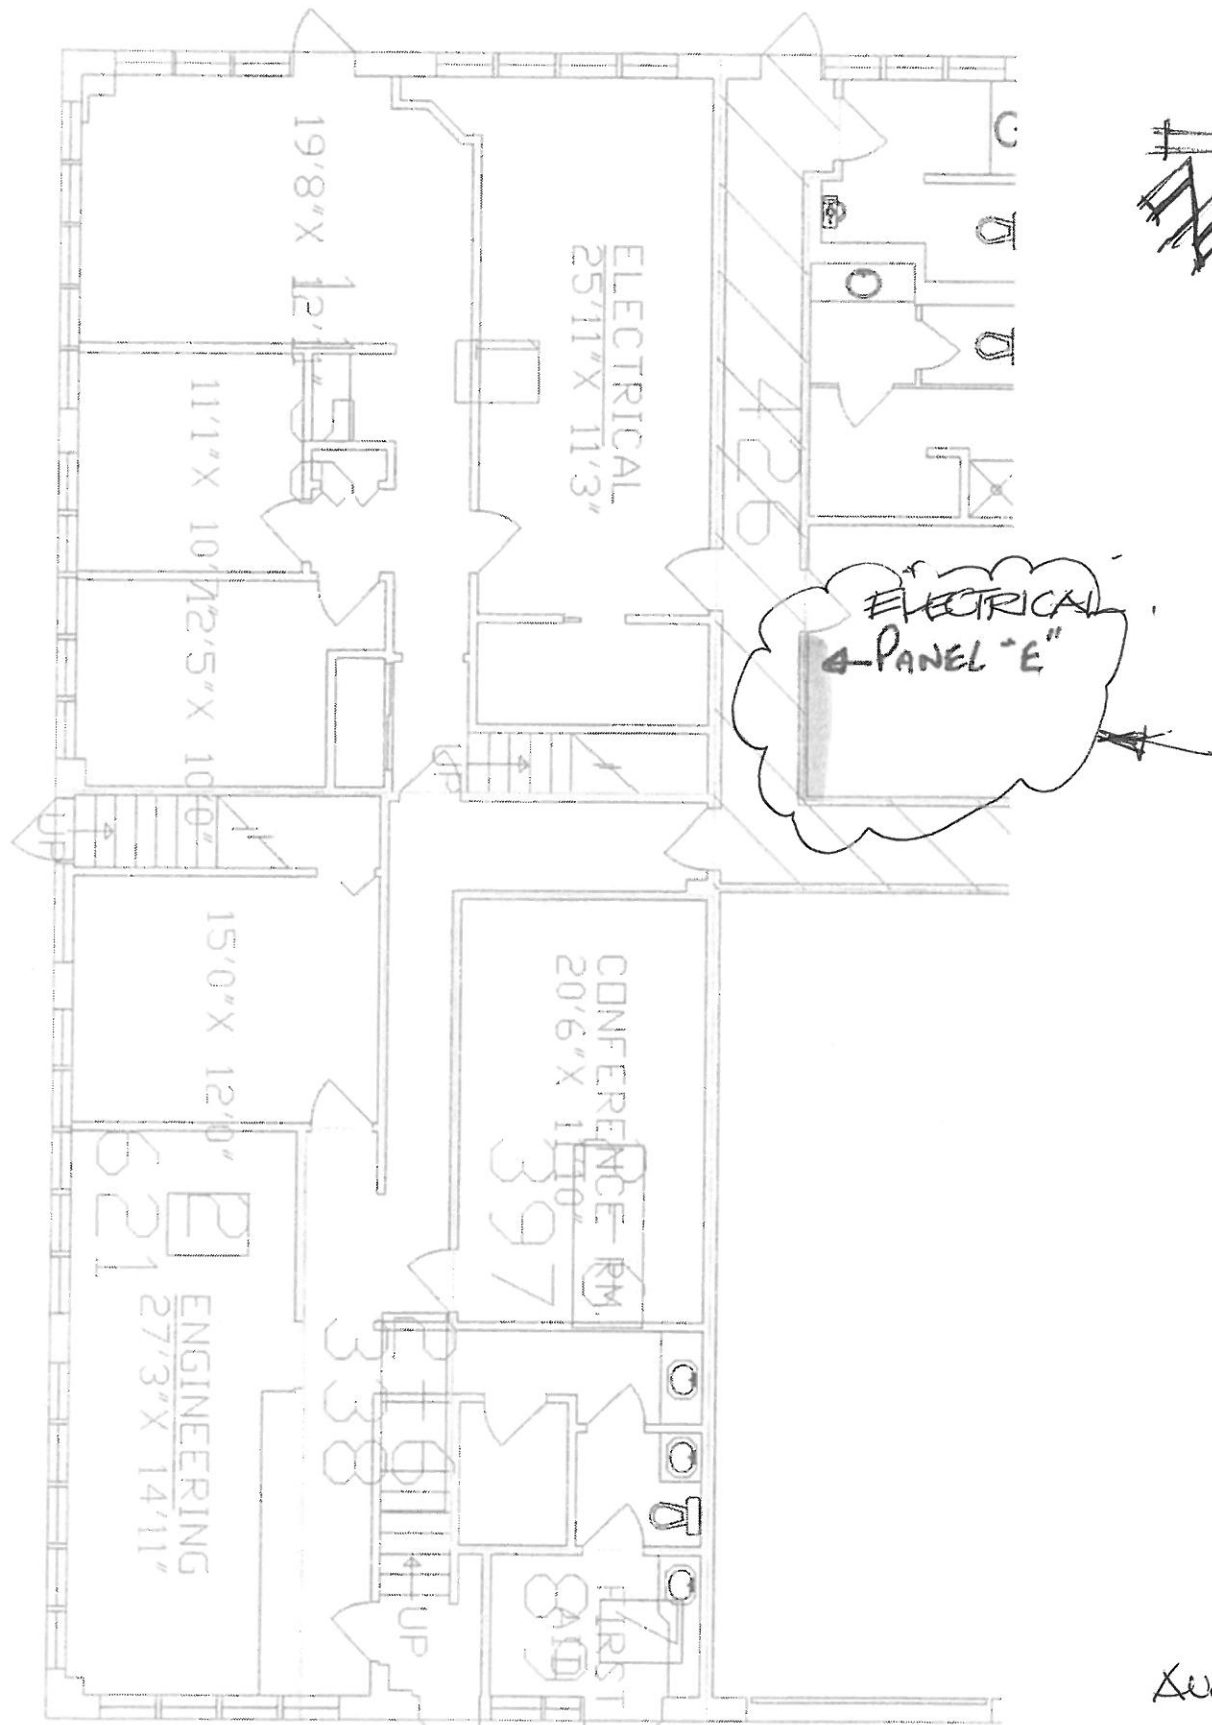

AUG. 18/10

PART MAIN FLOOR PLAN. - HEAT PUMPS ADDITION  
 N.T.S.  
 ENGINEERING OPERATIONS MAIN BLDG. SKA-1